




December 16, 2008

2006 – 2008 Donner/Xstrata Drilling
◆ Stringer Sulphides “Copper Zone” intercept
● Pierce point at Copper Zone Level

FOOTWALL ALTERATION



Strong Chlorite
“Pipe” Alteration

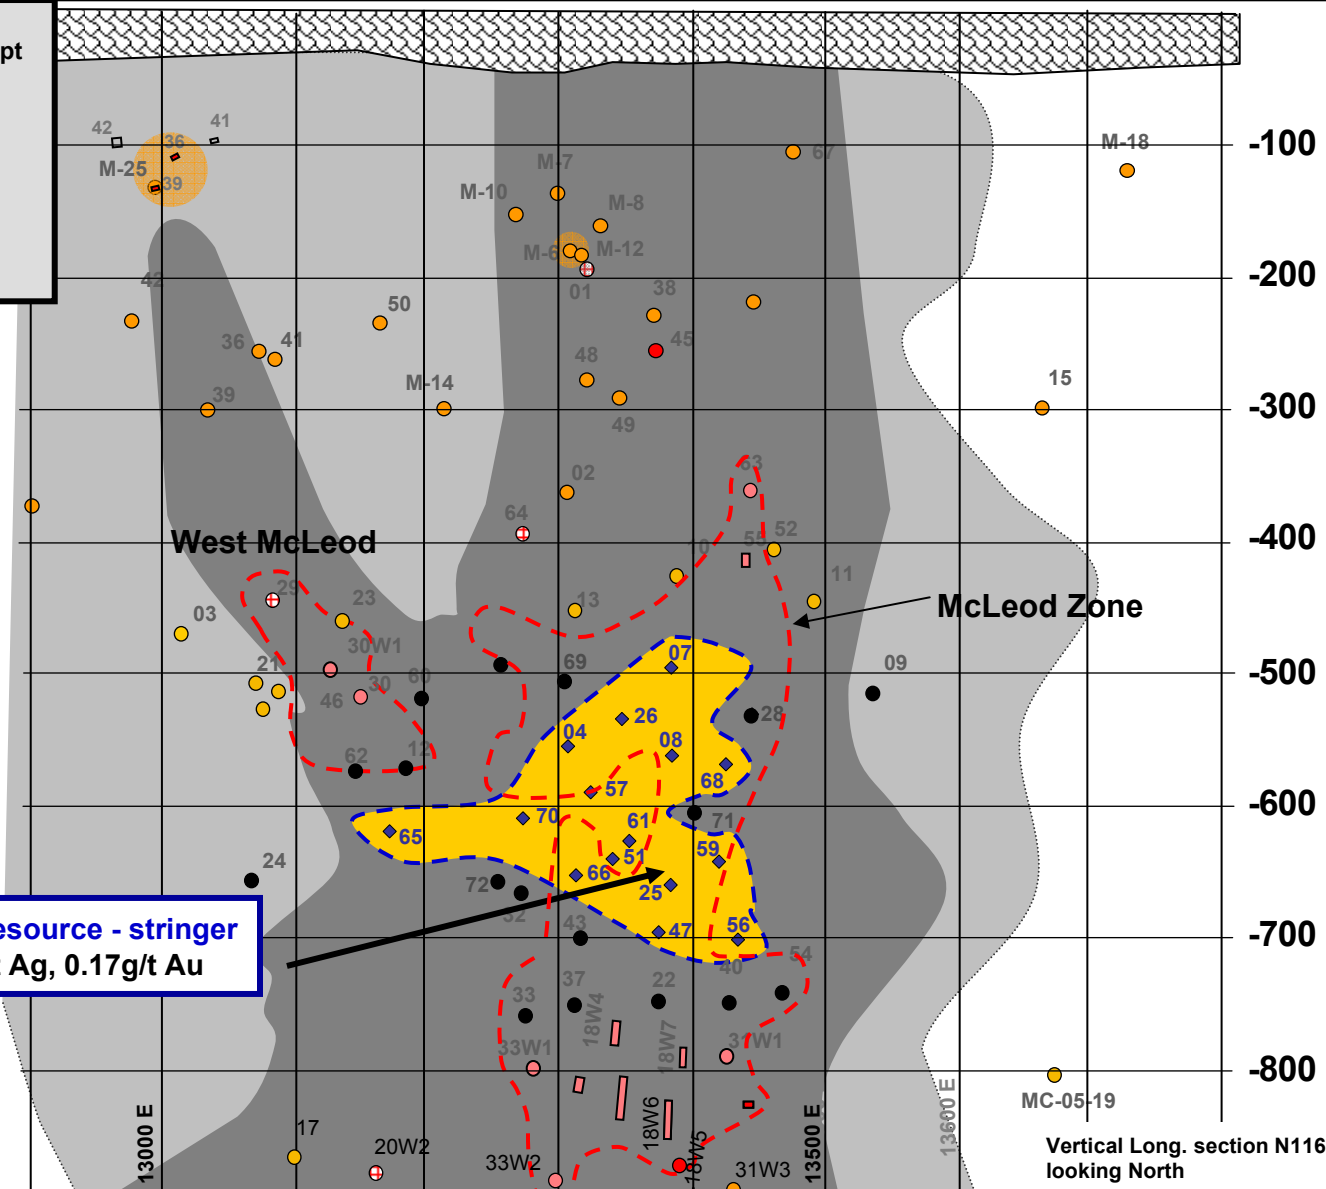

Copper Zone (in footwall) Inferred Resource - stringer
0.35Mt @ 0.89% Zn, 1.50%Cu, 6.97g/t Ag, 0.17g/t Au